

Cut-Off Relay 2-gang with auxiliary input

Order No.: 0387 00

Installation

The cut-off relay 0387 00 is installed in a common, splash-proof junction box. Fastening of the junction box occurs with two screws. After installation, all cable connections must be made in accordance with the terminal diagram.


Important: During connection, the relevant VDE requirements, especially DIN VDE 0100/0700, the applicable regulations of the local power supply company and the accident prevention regulations are to be observed.

Operation


The cut-off relay 0387 00 is used for the simultaneous control of two drives.

Note: Individual operation is only possible with mechanically and electrically locked push buttons. All devices with 230 V output and 2-minute pulse would be suitable as a controller. As long as a central command is active, no individual operation is possible.


Terminal diagram

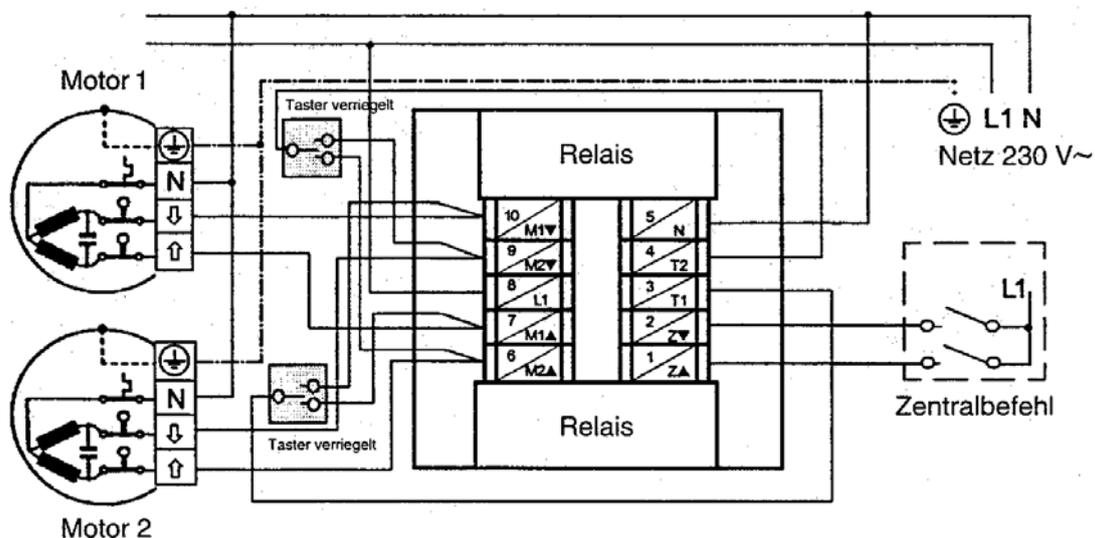


Internal circuit diagram

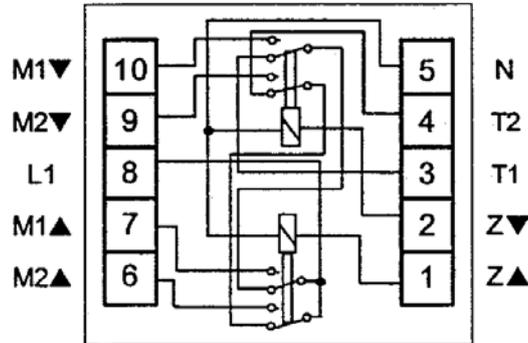

Parallel connection of cut-off relays

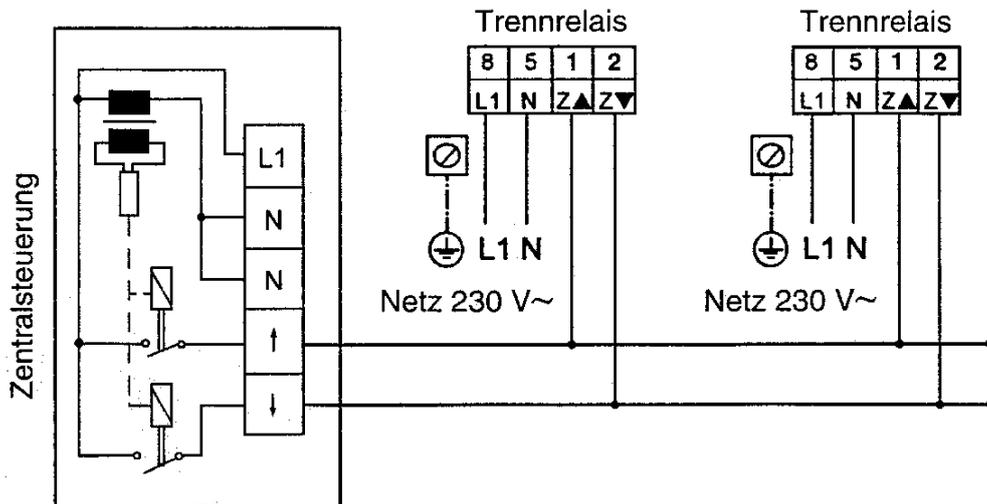

Dimensions

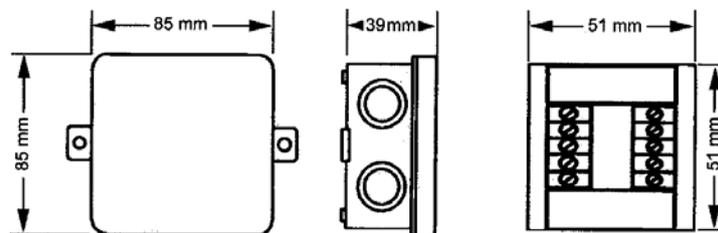

Technical data

- Mains: 230 VAC/50 Hz
- Controller: 230 VAC/50 Hz
- Contact rating: 4 A, 230 VAC, $\cos. \varphi \geq 0.8$

Warranty

We provide a warranty in accordance with the statutory requirements.

Please send the device postage paid with an error description to our central customer service centre.

Gira
Giersiepen GmbH & Co. KG
Service Center
Dahlienstraße 12
D-42477 Radevormwald

Gira
Giersiepen GmbH & Co. KG
Postfach 1220
D-42461 Radevormwald

Tel: +49 (0) 2195 / 602 - 0
Fax: +49 (0) 2195 / 602 - 339
Internet: www.gira.com